



Installation Manual
WZ cables and WZ mats
Manuel d'installation
Câbles et tapis de chauffage WZ

Table of Contents

WZ Snow Melting System	2
WZ Cable/Mat	3
Warnings	4
General Installation Guidelines	5
Sensor Installation	6
Sensor Placement	7
Installing the Heating Mat/Cable	8
Concrete Installation	9
Asphalt Installation	11
Stonework Installation.....	12
Warranty	14

Table des Matières

Fondeuse à neige WZ.....	15
Câble/tapis WZ.....	16
Mises en garde.....	17
Lignes directrices générales d'installation.....	18
Installation du détecteur.....	19
Placement du détecteur.....	20
Installation du tapis/câble de chauffage.....	21
Installation dans le béton.....	22
Installation dans l'asphalte.....	24
Installation dans la maçonnerie.....	25
Garantie	27

Warmzone CZ Snow Melting System



ClearZone Snow Melting System

The CZ Snow Melting System consists of the GX 850 Automatic Control Panel (ACP), heating cables or heating mats and multiple digitally operated sensors which provide an economical and efficient means of snow melting and ice protection. Built for outdoor use, the WZ system provides safety and peace of mind to homeowners and business owners alike. Engineered for surfaces such as asphalt, concrete and paving tiles the CZ Snow Melting System is both versatile and easy to install. The CZ Snow Melting System operates automatically by digitally sensing moisture and temperature.

The CZ System is embedded during the paving installation, such that some control and accessories must also be installed at this time.

It is recommended to install thermal insulation below the application of the heating cables or mats. Improved performance and efficiency will decrease overall operating costs.

CAUTION!

It is important that this equipment is only installed by qualified electricians who are familiar with the proper sizing, installation, construction and operation of outdoor heating systems and the hazards involved. The WZ system is designed for outdoor ice and snow melting applications only.

Note!

The installation shall be in accordance with the manufacturer's instructions and national and local electrical codes. The installation shall be in accordance with Part 426, American National Standard Institute / National Fire Protection Association (ANSI/NFPA70), National Electrical Code (NEC) and Canadian Electrical Code (CEC), Part 1. You must use a ground fault equipment protection (GFEP) device for outdoor areas.

WZcables and WZmats



ClearZone snow melting cables are the basis of an electric snow melting system designed to ease the snow removal process as well as lessen its environmental impact. The CZ system is both efficient and economical. It consists of twin conductor heating cables and a single point connection with a 20' (6m) power lead. ClearZone cables are CSA certified.

- Snow melting cables/mats suitable for concrete, asphalt, pavers, and stonework
- Ideal for driveways, parking lots, sidewalks, stairs, ramps, loading areas and bridges
- Reduces the environmental impact of snow and ice removal by eliminating the use of fossil fuel driven snow blowers, snowplows, rock salt and/or other chemicals
- Silent, efficient, automatic and safe
- Single point connection
- Zero EMF's
- Genuine ten year warranty

CZcable / CZmat Specifications

Type:	Twin conductor
Voltage:	240, 480V
Output:	37,5 W/sq.ft. (400W/m ²) Cable 12W/ft
Heating Element Size:	
Mat	6.5' (1.98 m) - 80' (24.38 m) long x 2' (0.61 m) wide
Cable	288' - 536' (87.8 - 164 m)
Power Lead	20' (6.0 m)
Bending Radius:	Minimum 1.5" (3.8 cm)
Cable Diameter:	1/4" (0.65 cm)
Conductor Insulation:	FEP Teflon
Outer Insulation:	PVC
Max. Temperature:	220°F (105°C)
Min. Installation Temp.:	40°F (5°C)

Connection (all voltages)

Phase - Black
 Phase- White
 Ground - Green

Warnings

Caution!

Is it important to read the instructions carefully before installing the CL Snow Melting System.

- **For outdoor installation only;**
- **Never cut the black heating cable;**
- Extreme care must be used to ensure the CZ cables are not damaged when using sharp tools, wheelbarrows, heavy machinery and paving equipment, shovels, rakes, or other implements. Avoid walking on the cables or mats during installation;
- It is not recommended to install the ClearZone heating mats with a controller that does not contain an integrated temperature limiter;
- The CZ mat or CZ cable must be embedded in mortar or mortar mixture, concrete, sand or similar material;
- **The power lead/heating cable connection and at least 1' (30 cm) of the power lead must be embedded in the paved surface;**
- Remaining power lead should be run through the conduit
- The power lead may be extended if required;
- **Do not install the ClearLone cables in such a manner that two black heating cables touch, cross or overlap;**

Remember to always measure, verify and record the actual resistance throughout the installation process:

1. Out of the box
2. After installation
3. Before pouring the sand/concrete/asphalt
4. After surface material application

Record these values in the table on page 20 and on the warranty card, failure to do so will void the warranty;

- Measure the resistance between two live conductors as well as the resistance between each conductor and the ground wire.
- Warmzone recommends using a megaohmmeter to test the insulation resistance.
- Remember to check that the supply voltage matches the voltage required for your particular CZ product;
- Remember to place the labels as instructed in this manual;
- Metal structures or materials used for the support of or on which the ClearZone is installed must be grounded in accordance with CSA Standard C22.1, Section 10 and the NEC.

Please consult the Warmzone for any other questions, concerns or advice.

General Installation Guidelines




Planning

It is recommended to sketch a plan of the layout for the heating system installation. Mat/cable location, sensor placement, junction boxes, conduits and the location of drains and other obstructions should be noted.


Mat Alterations

The CZ heating mats can be altered to accommodate drains, obstructions or bends in the layout. By carefully cutting the mat tape, many patterns and designs can be created. The figure below illustrates this.

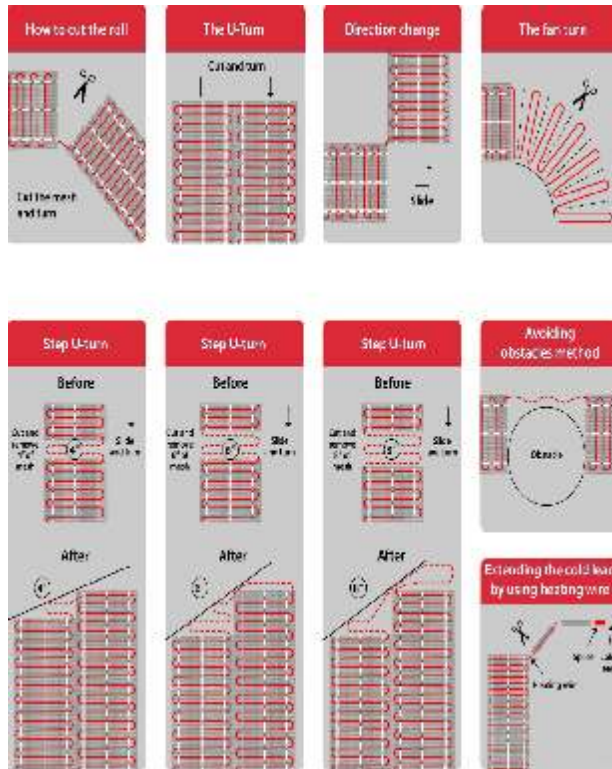

Free Cable and Cable Strapping

Should the cable strapping be used for the CZ cable, follow the instructions below for ease of installation.

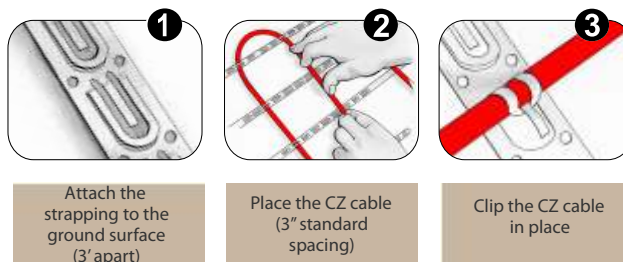

Installing a Feeder Cable

(For use with Gx850 and/or ground sensors, not applicable when using WZ-2B.)




A feeder cable for a sensor may be needed. A 50' (15m) cable is supplied with each sensor. Approx. 1.5' (0.5m) of this cable should be coiled inside the bottom of the sensor tube. The remaining cable may be lengthened. The feeder cable must be a four wire cable.

Installing a Sensor and a Conduit



The sensor and the conduit may be installed in connection with the actual construction work and connected at a later date. The following applies for all types of installations:

1. Ensure that the conduit is sealed when the concrete is poured.
2. The conduit must be positioned so that it is flush with the surrounding terrain. The sensor must be placed so that the upper brass surface is horizontal.
3. The base below the tube must be hard, e.g. a concrete tile, in order to ensure that the sensor is not pushed into the ground if for example a vehicle runs over it. The tube is designed to be mounted on a plate using the two screw holes inside the conduit.
4. A metal/plastic pipe, through which the sensor cable may be passed, should be run as far as the sensor conduit.
5. Coil approx. 1.5' (0.5m) of the sensor cable inside the conduit.
6. Place the sensor inside the tube until it is horizontally flush with the edge of the conduit and resting on the internal collar inside the conduit. The sensor may be extracted at a later date using the two holes found around the edge of the sensor conduit. The grooves on the outside of the sensor should correspond with the holes in the conduit.

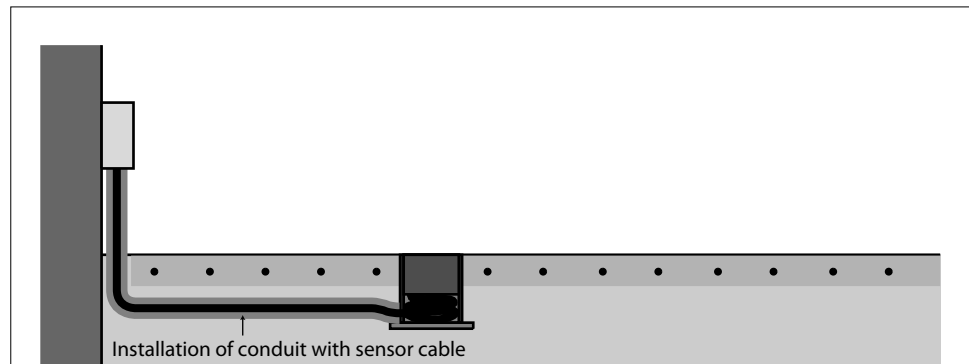

Installation in Asphalt



The temperature must not exceed 176°F (80°C) around the sensor/tube. A wooden block or similar place holder may be used in the area where the tube/sensor can be placed subsequently. The installation pipe used for the sensor cable should, in that case, be a metal tube that can withstand high temperatures.


Placement of Ground Sensors



Correct placement of the sensor(s) is important for the system to work as intended. Some basic guidelines follow:

The number of ground sensors:


1. The more sensors added to the system the better the performance.
2. The basic principle is to place one sensor where the snow/ice will appear first (for fast detection) and one sensor where the snow/ice will disappear last (for complete melting). If it is not obvious just place the sensors as far apart from each other as possible.
3. With only one sensor you will have to decide what is most important:
 - a) fast detection and activation of the system or
 - b) securing a complete melting of all snow/ice. A one sensor ground system will be slower in terms of detection and activation than a two sensor ground system, where one sensor measures the ground temperature and the other sensor measures the moisture.
4. With more than two sensors it is possible to cover problem spots where snow usually is not detected or where snow is not completely melted when the system stops.

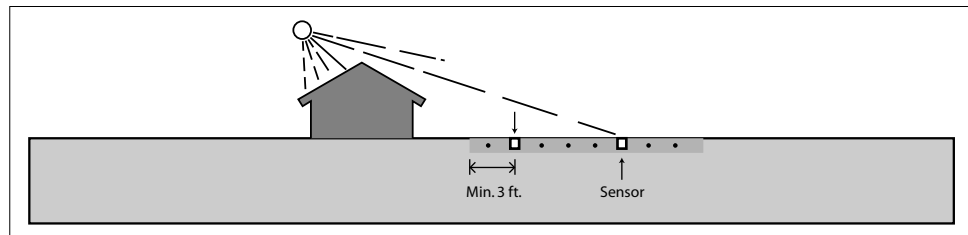

Placement of Individual Ground Sensors



1. The sensor must be placed within the heated area and at least 3.3' (1 m) from the edge of the area, if possible.
2. The sensor must be placed in between the heating cables - a distance of minimum 0.4" (1 cm) should be maintained between the sensor tube and the heating cable.
3. There must be a distance of minimum 3.3ft. (1 m) between the two sensors.

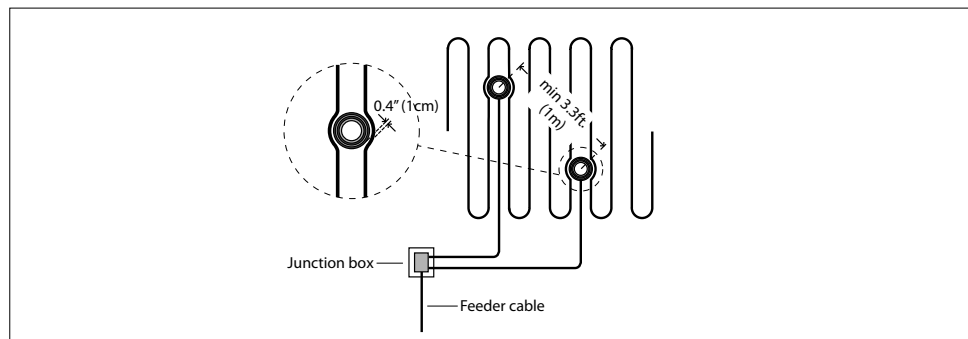

Installing the heating mat



Begin by fastening the heating mat to the mesh reinforcement using tie-wraps or cable strapping. Do not fix the heating cable of the mat in such a way that it is compressed or strained - it must be able to move. Unroll the mat up to the point at which it is to be flipped and turned. Use the figure on page 5 to alter the mat.

Cut the tape using scissors and rotate the mat so that it can be unrolled to cover the area next to the already unrolled mat. **Do not cut the cable!** The cable can be carefully detached from the tape and then placed as free cable. This feature can be very useful for curves and around drains or other obstructions.

Labels:

Labels 2E or F are to be placed at the switchboard

Labels 3E and F are to be placed in the room or area where the heating mat/cable is installed

Installing the heating cable



The CZ cable must be laid out with even spacing over the entire area to be heated. To ensure an accurate and easy method of installing the CZ cable it is recommended to use cable strapping. Attach the cable strapping to the rebar or other supporting structure using tie-wraps. The strapping should be laid perpendicular to the direction the cable will be unrolled. Space the strapping 3' (75cm) apart. Secure the heating cable to the cable strapping at the correct center-to-center distance. Do not secure the cable too tightly as this may damage the cable. If not using the cable strapping, affix the heating cable to the rebar or wire mesh using tie wraps.

Labels:

Labels 2E or F are to be placed at the switchboard

Labels 3E and F are to be placed in the room or area where the heating mat/cable is installed

Center-to-Center (C-C) distance



The C-C distance is the distance between the CZ cables (CZ mats have a preset C-C distance). Standard spacing for 50W/sq.ft. (540W/m²) is 3" (7.5 cm). In a typical application the C-C distance should not exceed 4" and be less than 3" if the cables are installed as part of a total heating system. If the C-C distance is higher, cold spots may form on the surface and incomplete melting may occur.

Concrete Installation




When installing ClearZone heating cables the following should be observed:

- Begin installation as close as possible to electrical supply source. The heating cable must not be cut or shortened or exposed to strain in the areas of the cold tail/heating cable coupling.
- Insulation can be installed to improve efficiency of the heating system.
- When placing the sensors please see page 7.
- Special care should be taken not to damage the heating cables with tools and machinery during the installation and application of the surface material.
- Ensure that all sharp stones and debris are removed from the area where the heating cables are going to be installed.
- Should the cable become damaged during the installation process it is helpful to know the location of the cold tail/heating cable connection. Take a picture or sketch to show where the connection/end cap is in case a fault needs to be found.
- Connection of the heating cable must be carried out by an authorized electrician.
- Note the maximum output allowed for your installation. Do not exceed it. Contact Warmzone for questions/concerns.
- Make sure the cable is not subjected to excess tension or strain. It should not cross an expansion joint. Where expansion joints are present, separate mats/cables should be used.
- The heating cable braid must be grounded in accordance with local electrical codes.
- Make sure when the cable is laid it is not pushed into the insulating material.
- Ensure no air pockets exist in the surface material as this can result in damage to the cable and limit the heat transfer.
- An upstream disconnect must be installed to ensure a means of de-energizing the cable or mat.
- At low temperatures, the heating cable stiffens and may be difficult to work with. To overcome this, connect the cable to the mains for a brief period of time. Ensure the cable is fully rolled out when this is done.

Concrete Installation (continued)



- The cables are normally covered by 2 inches of concrete. A thicker surface may be required depending on the pour and application.
- Make sure that the free cable is fastened at intervals of minimum 3' (45 cm), as the concrete might move the cable when it is poured.
- The concrete mixture must not contain sharp stones as these may damage the cable.
- The concrete should be allowed to set for 30 days before the heating cables are turned on.
- It is not recommended for the ClearZone mat or cable to cross an expansion joint.

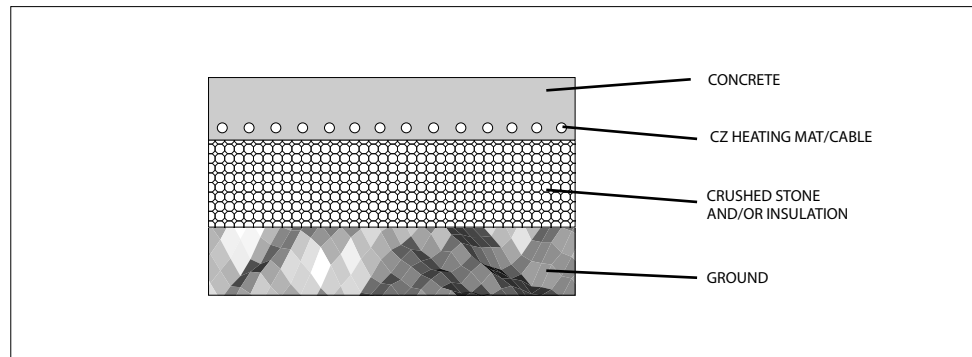

Asphalt Installation




When installing heating cables the following should be observed:

- Begin installation as close as possible to electrical supply source. The heating cable must not be cut or shortened or exposed to strain in the areas of the cold tail/heating cable coupling.
- Install cables in a direction perpendicular to the direction that the paving rollers will pass to prevent straining or damaging the cable.
- Insulation can be installed to improve efficiency of the heating system.
- When placing the sensors please see page 7.
- Special care should be taken not to damage the heating cables with tools and machinery during the installation and application of the surface material.
- Ensure that all sharp stones and debris are removed from the area where the heating cables are going to be installed.
- Should the cable become damaged during the installation process it is helpful to know the location of the cold tail/heating cable connection. Take a picture or sketch to show where the connection/end cap is in case a fault needs to be found.
- Connection of the heating cable must be carried out by an authorized electrician.
- Note the maximum output allowed for your installation. Do not exceed it. Contact Warmzone for questions/concerns.
- Make sure the cable is not subjected to excess tension or strain. It should not cross an expansion joint.
- The heating cable braid must be grounded in accordance with local electrical codes.
- Make sure when the cable is laid it is not pushed into the insulating material.
- Ensure no air pockets exist in the surface material as this can result in damage to the cable and limit the heat transfer.
- An upstream disconnect must be installed to ensure a means of de-energizing the cable or mat.
- At low temperatures, the heating cable stiffens and may be difficult to work with. To overcome this, connect the cable to the mains for a brief period of time. Ensure the cable is fully rolled out when this is done.

Asphalt Installation (continued)

- It is recommended to cover the cables with a layer of sand or concrete at least 1" (2.5 cm) before the asphalt is applied to protect them from the heat of the asphalt. Use of sand or concrete will ensure an effective and efficient heat transfer through the asphalt.
- If using sand or concrete, allow the asphalt to cool to a temperature of 265°F (130°C) maximum before pouring. If using without sand or concrete, allow asphalt to cool to 220°F/ (105°C) before pouring directly on mats/cables. Ground sensors/tubes should not be exposed to temperatures above 80°C (176°F.)
- The cables are normally covered by 2 inches of asphalt.
- A perimeter of maximum 12" (30 cm) of asphalt should exist, unheated around the embedded cables. This allows for adjustment of the paving surface edge without damaging the heating cable.
- The operating weight of the asphalt roller should not exceed 1000lbs.

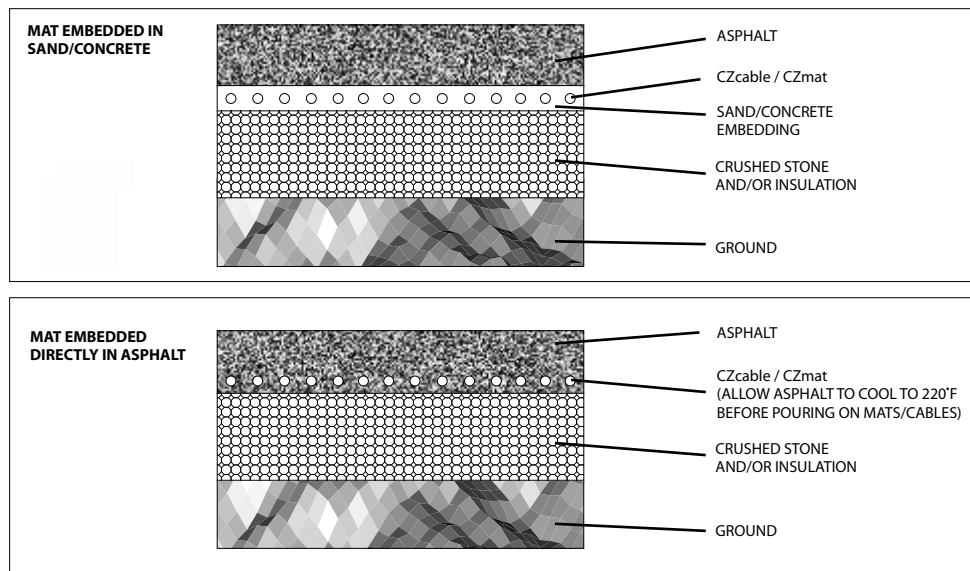

Stonework Installation

When installing heating cables the following should be observed:

- Begin installation as close as possible to electrical supply source. The heating cable must not be cut or shortened or exposed to strain in the areas of the cold tail/heating cable coupling.
- Insulation can be installed to improve efficiency of the heating system.
- When placing the sensors please see page 7.
- Special care should be taken not to damage the heating cables with tools and machinery during the installation and application of the surface material.
- Ensure that all sharp stones and debris are removed from the area where the heating cables are going to be installed.
- Should the cable become damaged during the installation process it is helpful to know the location of the cold tail/heating cable connection. Take a picture or sketch to show where the connection/end cap is in case a fault needs to be found.

Stonework Installation (continued)




- Connection of the heating cable must be carried out by an authorized electrician.
- Note the maximum output allowed for your installation. Do not exceed it. Contact Warmzone dealer for questions/concerns.
- Make sure the cable is not subjected to excess tension or strain. It should not cross an expansion joint.
- The heating cable braid must be grounded in accordance with local electrical codes.
- Make sure when the cable is laid, that it is not pushed into the insulating material.
- Ensure no air pockets exist in the surface material as this can result in damage to the cable and limit the heat transfer.
- An upstream disconnect must be installed to ensure a means of de-energizing the cable or mat.
- At low temperatures, the heating cable stiffens and may be difficult to work with. To overcome this, connect the cable to the mains for a brief period of time. Ensure the cable is fully rolled out when this is done.



Special care must be taken not to damage the heating cables when they are installed under bricks or tiles.

The area must be completely level and free of stones or other sharp objects.

The heating cable must be installed close to the bricks or tiles, typically in a layer of sand (at least 1" (2.5 cm) under the brick).

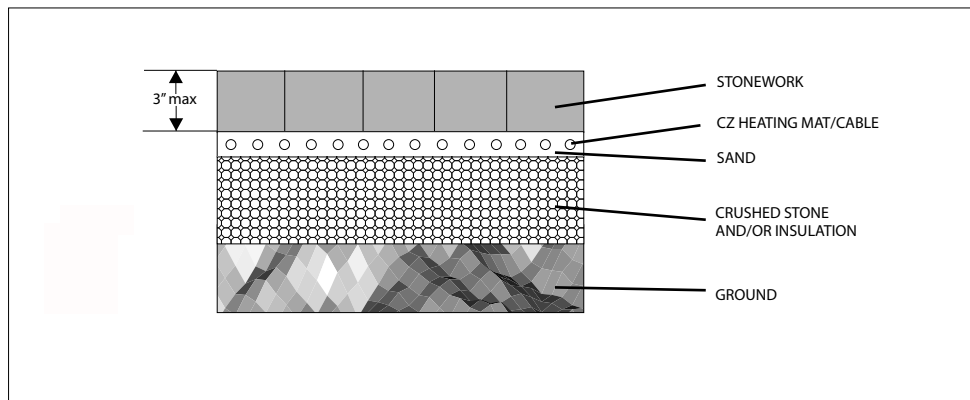

Warranty

For a period of ten (10) years from the date of manufacture, Manufacturer warrants to the original purchaser that the electrical mats and cables ("Product") are free from defects in materials and workmanship under normal use and maintenance, provided the Product is installed in accordance with the accompanying installation manual, any special written design or installation guidelines for a particular project, the National Electrical Code (NEC) or the Canadian Electrical Code (CED), and all applicable local building and electrical codes. The limited warranty is valid only if the warranty certificate has been properly completed and mailed. Warranty is for Product only and does not cover thermostats, controls or any other equipment.

Under this Limited Warranty if the Product is determined by Manufacturer to be defective in materials and workmanship, has not been damaged as a result of abuse, misapplication, misuse, modification, neglect, alteration or improper installation, operation, maintenance, repair or testing, the Manufacturer will repair Product or supply replacement Product or refund the purchase price of the Product on Product covered by this Limited Warranty whichever Manufacturer may elect at its sole discretion.

This Limited Warranty does not cover and Manufacturer shall in no event be liable for:

1. Any direct, indirect, incidental or consequential damages, including inconvenience, loss of time, loss of or damage to or loss of use of facilities or other property, loss of revenue, loss of anticipated profits or loss of income.
2. Any labor or materials required to repair or replace the Product that is not authorized in writing by Manufacturer.
3. Any labor or materials required to remove, repair or replace covering materials.
4. Any freight or delivery costs related to the Product, or any related covering or electrical products.

Manufacturer assumes no responsibility under this warranty for any damage to the Product caused by any persons; including any trades people or owners or visitors to the job site or damage caused as a result of pre or post-installation work.

MANUFACTURER DISCLAIMS ANY WARRANTY NOT PROVIDED HEREIN, INCLUDING ANY IMPLIED WARRANTY OF MERCHANTABILITY OR IMPLIED WARRANTY OF FITNESS FOR A PARTICULAR PURPOSE. MANUFACTURER FURTHER DISCLAIMS ANY RESPONSIBILITY FOR SPECIAL, INDIRECT, SECONDARY, INCIDENTAL, OR CONSEQUENTIAL DAMAGES ARISING FROM OWNERSHIP OR USE OF THIS PRODUCT, INCLUDING INCONVENIENCE OR LOSS OF USE. THERE ARE NO WARRANTIES WHICH EXTEND BEYOND THE FACE OF THIS DOCUMENT. NO AGENT OR REPRESENTATIVE OF MANUFACTURER HAS ANY AUTHORITY TO EXTEND OR MODIFY THIS WARRANTY UNLESS SUCH EXTENSION OR MODIFICATION IS MADE IN WRITING BY A CORPORATE OFFICER.

Some states do not allow the exclusion or limitation of implied warranties or liability for incidental or consequential damages, so the above limitation or exclusion may not apply to you. This warranty gives you specific legal rights, and you may have other rights, which vary from state to state.

Incoming materials should be inventoried and a resistance reading taken immediately for completeness and for possible shipping damage. Any visible damages or shortages must be noted prior to accepting the material. Any discrepancy concerning type or quantity of material shipped or Ohms measurements must be brought to the attention of Manufacturer or Manufacturer authorized agent within 15 days of the shipping date entered on the packing slip for the order.

How to Claim this Warranty

In order to receive the remedy set forth above, you must return the product during the warranty period and include sufficient details relating to the nature of the defect, the installation, the history of operation, and any repairs that may have been made, including:

1. Provide Resistance readings taken by installer, Ohms measurement: within 4 hours before installing Product, after installing Product, and after covering is installed over Product.
2. Provide proof that Product was installed in accordance with the installation manual, any special written design or installation guidelines, the National Electrical Code (NEC) or the Canadian Electrical Code (CED), and all applicable local building and electrical codes.
3. Provide dated proof of purchase.

Warranty Registration

Mail: PO Box 1268
Riverton, UT 84065
Phone: 801.948.7566